

ELEKTROTECHNICKÝ ZKUŠEBNÍ ÚSTAV



ELECTROTECHNICAL TESTING INSTITUTE - CZECH REPUBLIC
ELEKTROTECHNISCHE PRÜFANSTALT - TSCHECHISCHE REPUBLIK
INSTITUT ELECTROTECHNIQUE D'ESSAIS - RÉPUBLIQUE TCHÉQUE
ЭЛЕКТРОТЕХНИЧЕСКИЙ ИСПЫТАТЕЛЬНЫЙ ИНСТИТУТ - ЧЕШСКАЯ РЕСПУБЛИКА

Pod Lisem 129, 171 02 Praha 8 - Troja

CERTIFICATE

No.: 1150071

Product: Empty enclosure

Type: RZB., RNB.. (variant see enclosure)

Rating: 400 V AC, IP 30/20, IK 09, indoor use

Ordering firm: OEZ s.r.o.
Šedivská 339, 561 51 Letohrad, Czech Republic

Manufacturer: B a K production s.r.o.
Purkratice 18, 397 01 Písek, Czech Republic

Trade mark:

The test results are stated in the test-report No.: 500282-01/01 of: 30.01.2015

A sample of the product was found to be in conformity with:
ČSN EN 62208 ed.2:12

The validity of the certificate is limited to: 28.2.2018

4.2.2015

Prague

Miroslav Sedláček
Head of Certification Body



Stamp




500282-01

Type marking of distribution boards RxB DistriTon

Supplied as empty distribution boards - ČSN EN 62208

Example: **R Z B - 2 N 48 - B**

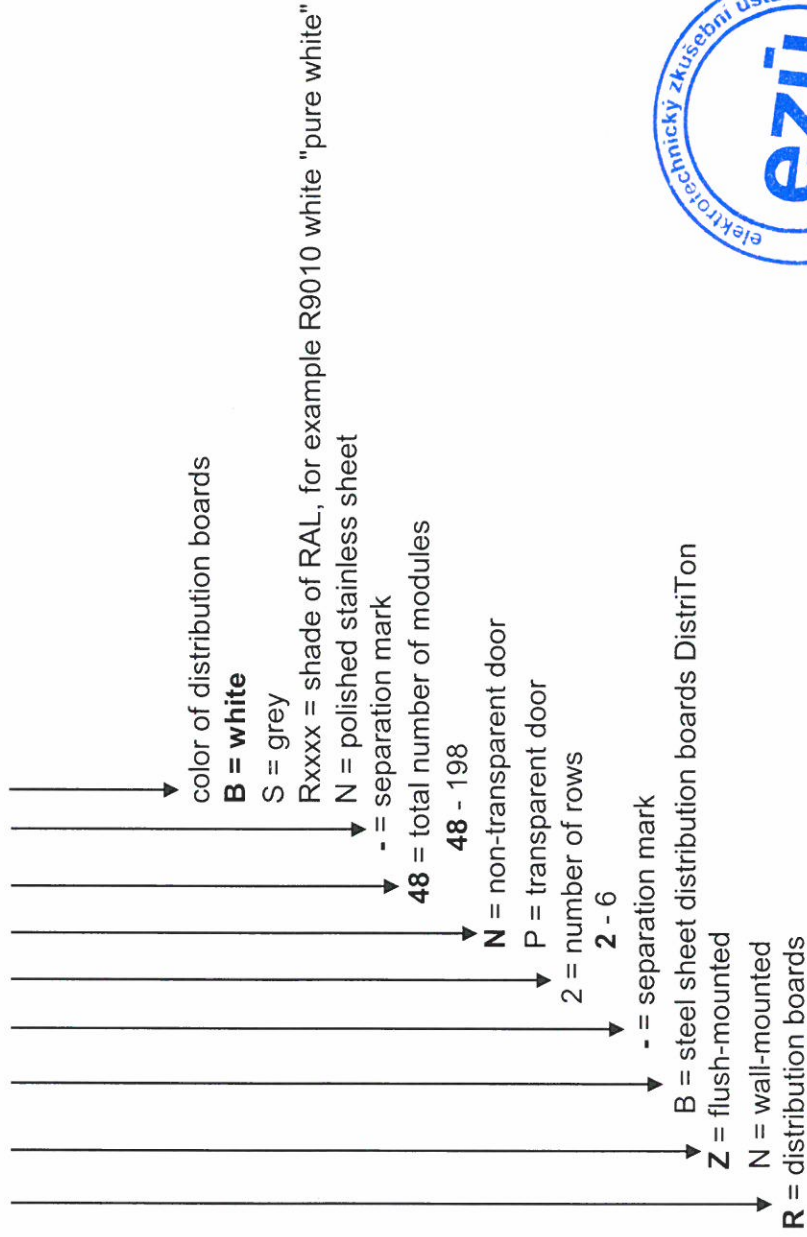

Legend:

